


CHP System at Fonda-Fultonville



PowerCommand™

Digital Master Control

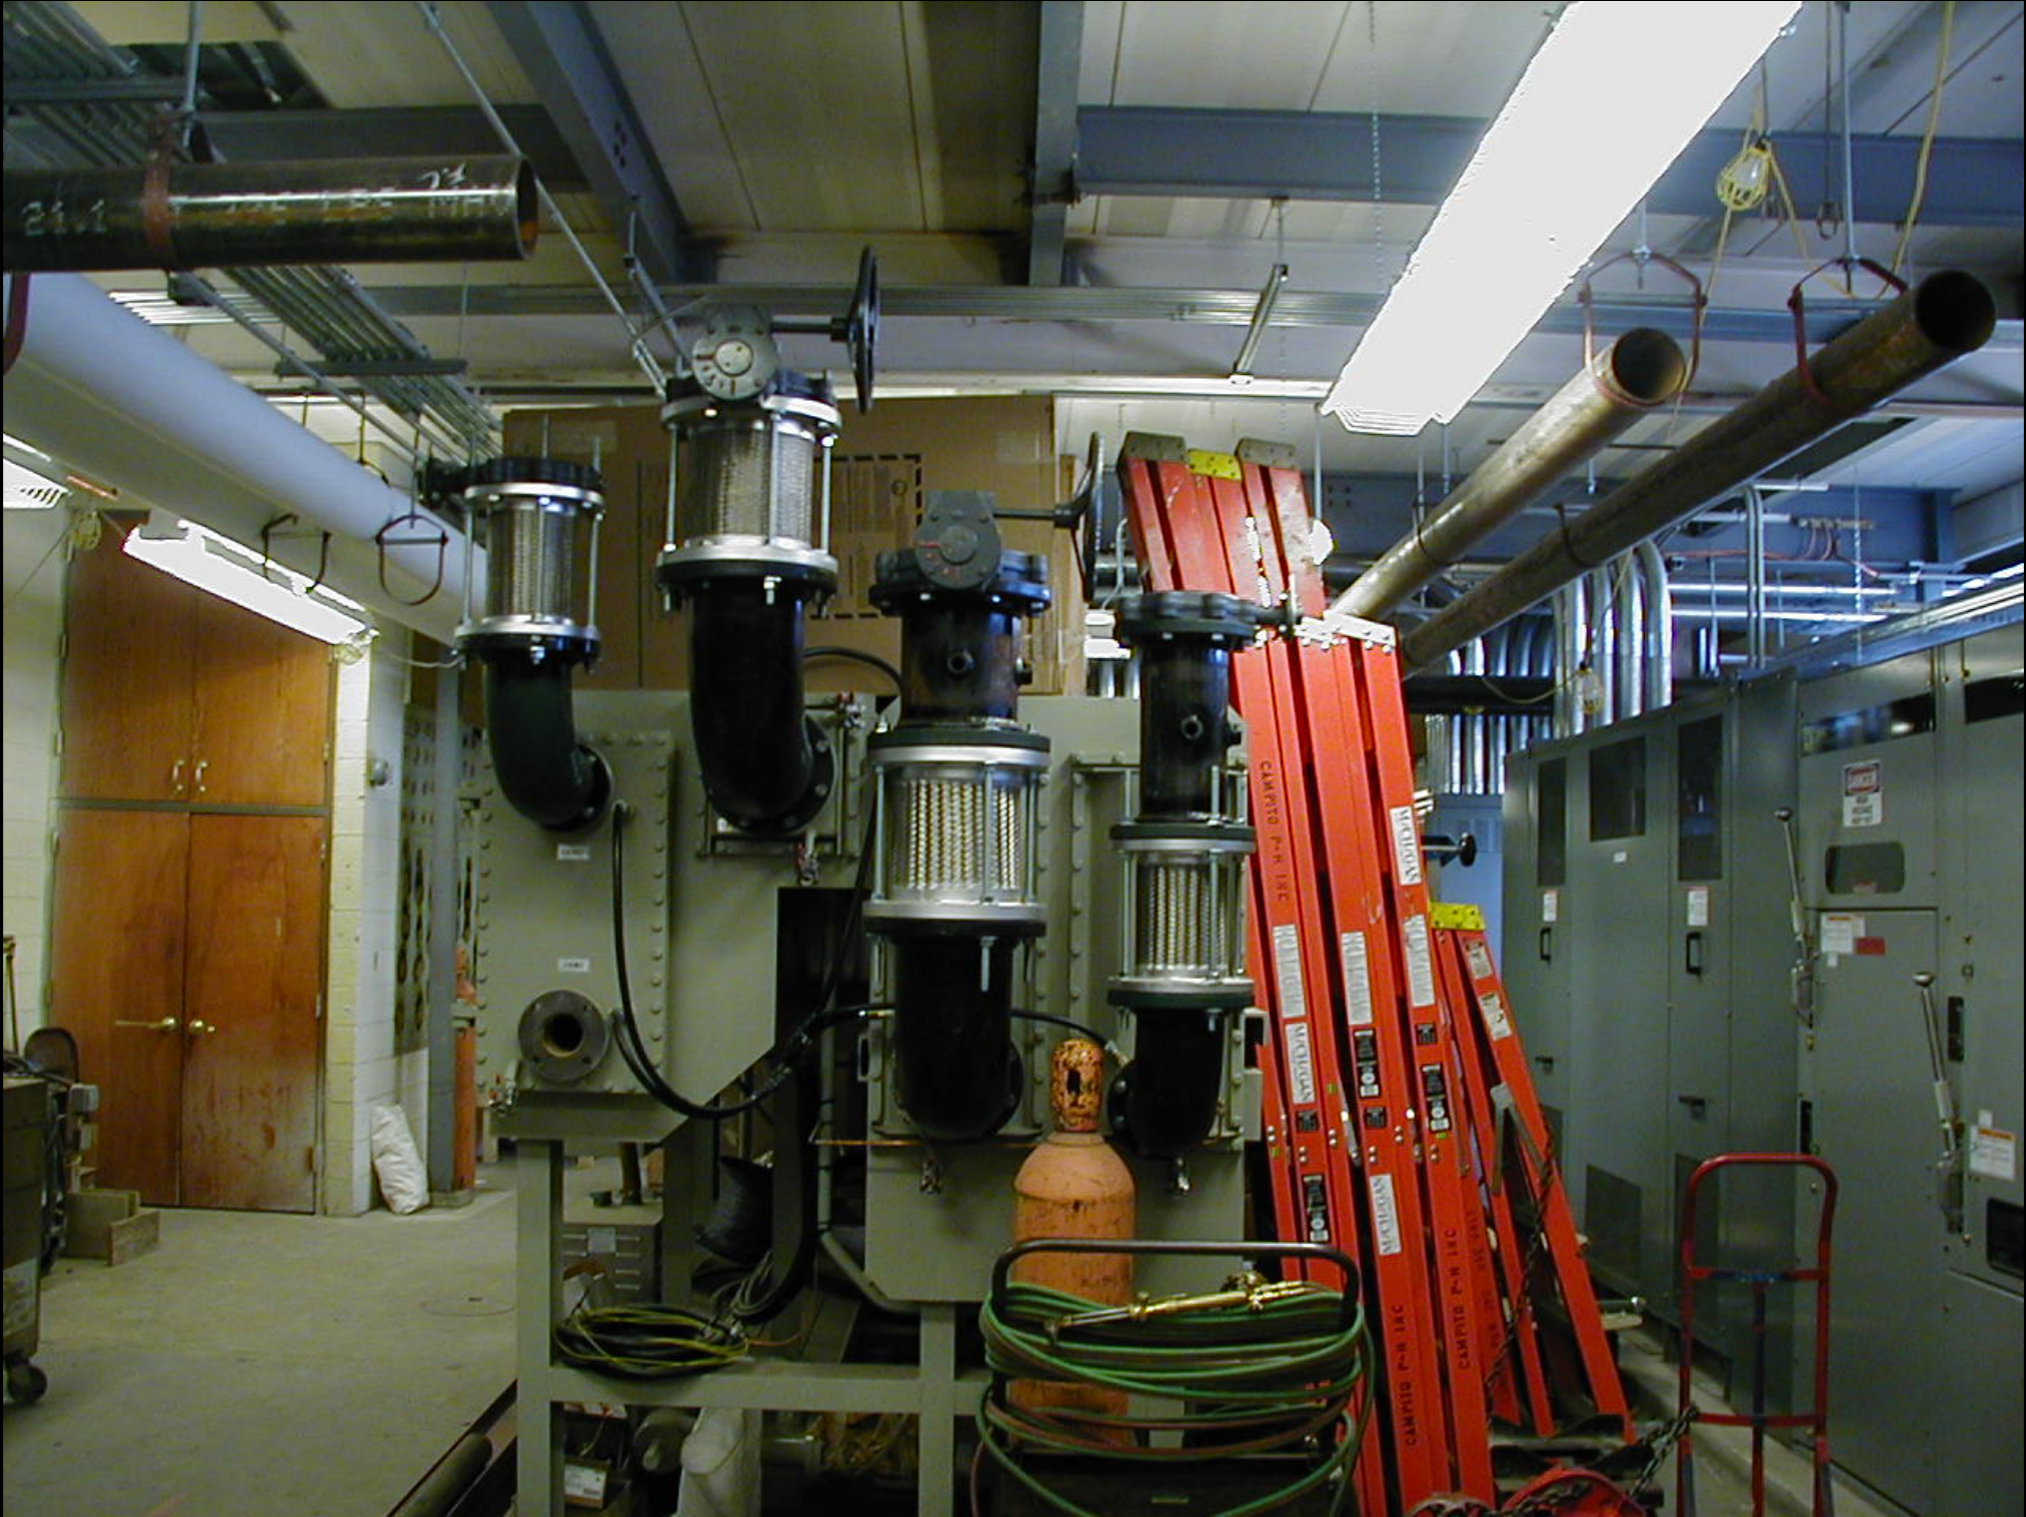

04/06/2004 14:27:44

System Runtime:
2886 Minutes



Total System Load

Running

Control

Summary



31 %kW
52-G1

Running

Control

Summary



34 %kW
52-G2

Running

Control

Summary



33 %kW
52-G3

Running

Control

Summary



32 %kW
52-G4

52-GM



MAIN
MENU


SYSTEM
CONTROL

04/06/2004 14:27:54

System Runtime:
2886 Minutes



Total System Load

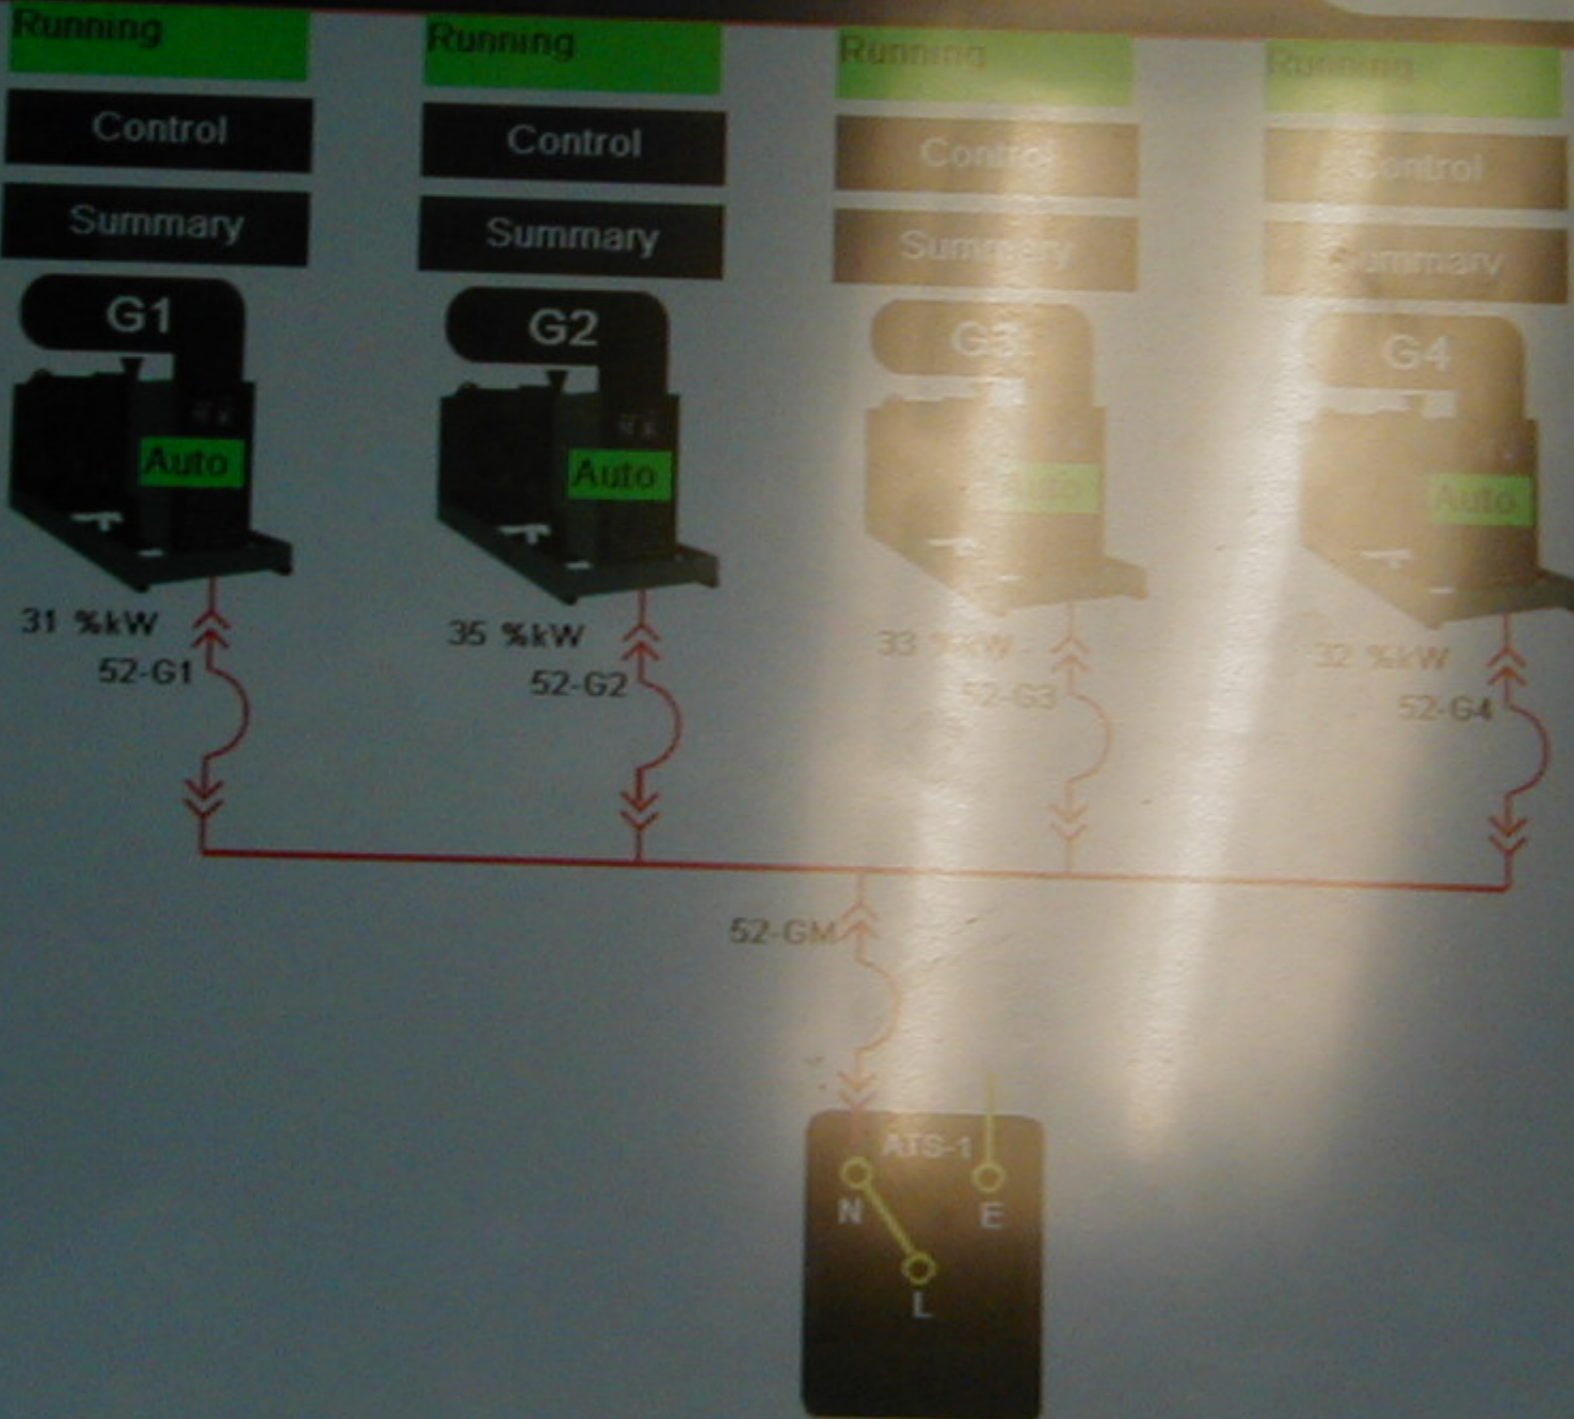









FAN CEX-4

FAN CEX-3

FAN CEX-2

FAN CEX-1

FAN CEX-1

ECONOFLEX
Advanced Control System

ECONOFLEX
Advanced Control System

ECONOFLEX
Advanced Control System

ECONOFLEX
Advanced Control System

ECONOFLEX
Advanced Control System



6

Control panels with various indicators and switches, including red and yellow lights, and control handles.